

LM-79-08 Test Report

For

L-TECH CORPORTION (Brand Name: L-TECH CORP)

SHAOGANGTOU DISTRICT.QIAOTOU TOWN.DONGGUAN
CITY.GUANGDONG PROVINCE,CHINA

LED Luminaire

Model name(s): LRKT448W-EN-4090

Representative (Tested) Model: LRKT448W-EN-4090

Model Different: N/A

Test & Report By:

Univ Xie

Engineer: Univ Xie

Date: Jan17, 2017

Review By:

Tommy Liang

Manager: Tommy Liang

Note: This report does not imply product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government.

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2


Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

1.1 Product Information:

Organization Name	L-TECH CORPORTION	
Brand Name	L-TECH CORP	
Model Number	LRKT448W-EN-4090	
SKU (if available)	N/A	
Type of Luminaire (for integral lamps, list base type and lamp type)	LED Luminaire	
Rated Voltage / Frequency	120Vac, 60 Hz	
Nominal Power	11W	
Rated Initial Lamp Lumen	--	
Declared CCT	4000K	
LED Manufacturer	Edison Opto Corporation	
LED Model	2T03X5	
Sample Number	GZE1612120-AN1	
Luminaire Aperture (for downlights)	--	in.
Luminaire Length	--	mm
Luminaires Width	--	mm
Number of Units (modular products)	N/A	s

Photo

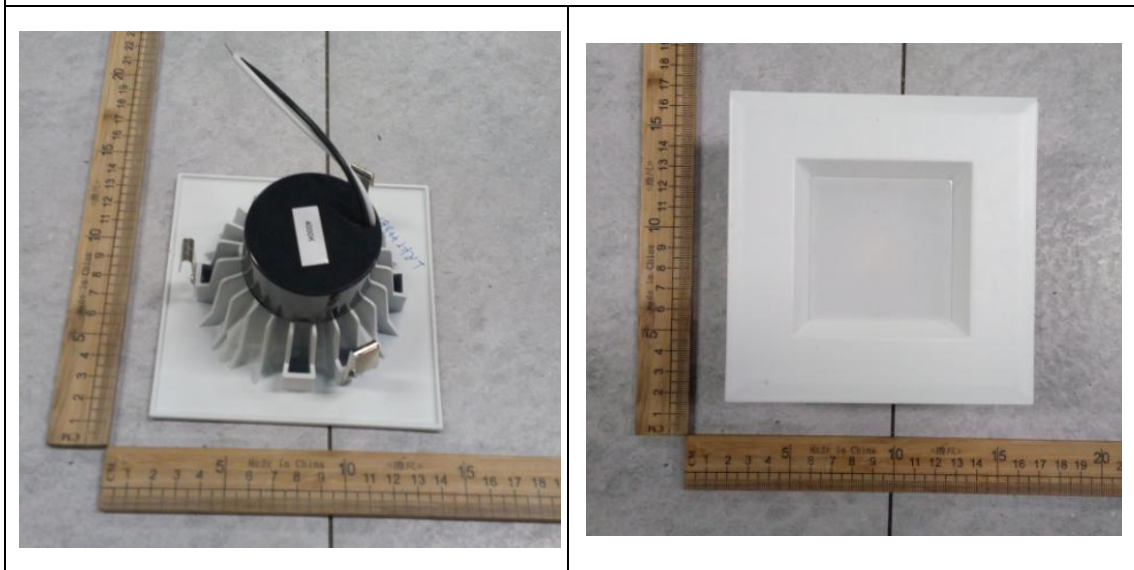

1.2 Test Specifications:

Date of Receipt	Jan08, 2017
Date of Test	Jan.11, 2017
Test item	<ol style="list-style-type: none"> 1. Total Luminous Flux 2. Luminous Distribution Intensity 3. Luminous Efficacy 4. Correlated Color Temperature 5. Color Rendering Index 6. Chromaticity Coordinate 7. Electrical Parameters
Reference Standard	<ol style="list-style-type: none"> 1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products 2. ANSI C78.377-2008 Specifications for the Chromaticity of Solid State Lighting Products 3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources 4. CIE 15-2004 Technical Report Colorimetry 5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source 6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems
Reference Work Instruction	QD25

1.3 Test Methods

<p>1) Photometric and Light Distribution Measurement – Goniophotometer Method:</p> <p>Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals.</p>
<p>2) Chromaticity Measurement – Sphere-Spectroradiometer Method:</p> <p>Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25° C ± 1° C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.</p>
<p>3) Electrical Measurements:</p> <p>Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25° C ± 1° C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.</p>

2.1 Electrical, Photometric and Chromaticity Measurements

(Refer to Work Instruction QD25)

Test date	2017-01-11	Test Ambient:	25.2 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	LRKT448W-EN-4090		

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
GZE161212 0-AN1	120.0	60	0.0890	10.08	0.9438


Chromaticity Measurement - Sphere-Spectroradiometer Method:

Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120.0	R1	94	R9	69
Frequency (Hz)	60	R2	96	R10	88
CCT (K)	4051	R3	96	R11	93
Duv	0.0014	R4	93	R12	72
Chromaticity (x, y)	x=0.3791 y=0.3789	R5	92	R13	94
Chromaticity (u', v')	u'=0.2234 v'=0.5023	R6	93	R14	97
Color Rendering Index (CRI)	93.4	R7	96	R15	91
R9	69	R8	88	--	--

Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	745.58
Luminous Efficacy (lm/W)	73.97
Beam Angle (°)	98.6
Center Beam Candle Power (cd)	316

Spectral Power Distribution & Chromaticity Diagram

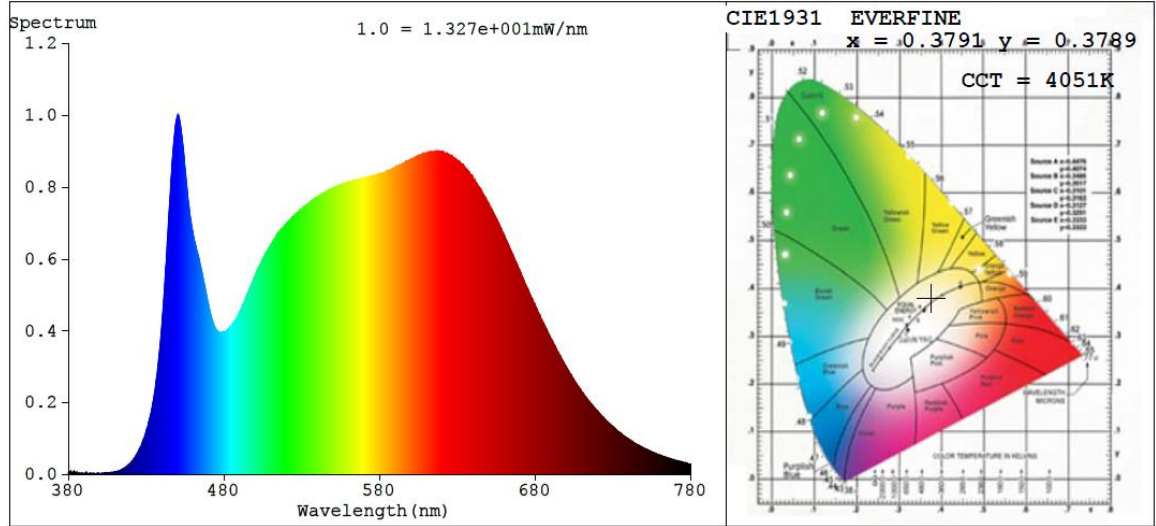


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	238.3	32%
0-40	382.0	51.2%
0-60	638.1	85.6%
60-90	106.7	14.3%
70-100	31.4	4.2%
90-120	0.2	0%
0-90	744.8	99.9%
90-180	0.7	0.1%
0-180	745.5	100%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	29.8	4.0%	90-100	0.1	0%
10-20	84.2	11.3%	100-110	0.1	0%
20-30	124.2	16.7%	110-120	0.1	0%
30-40	143.7	19.3%	120-130	0.1	0%
40-50	140.3	18.8%	130-140	0.1	0%
50-60	115.8	15.5%	140-150	0.1	0%
60-70	75.3	10.1%	150-160	0.1	0%
70-80	28.4	3.8%	160-170	0.1	0%
80-90	3.0	0.4%	170-180	0.0	0%



Photometric Data

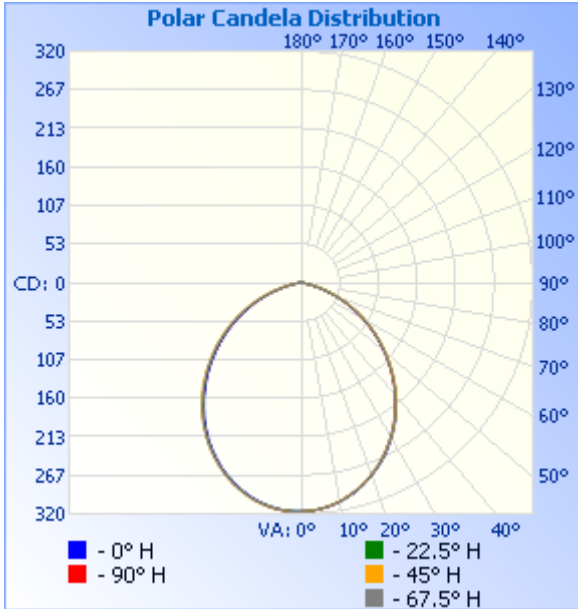

Illuminance at a Distance

	Center Beam fc	Beam Width	
17.0ft	1.10 fc	39.5 ft	39.5 ft
34.0ft	0.27 fc	79.0 ft	78.9 ft
51.0ft	0.12 fc	118.5 ft	118.4 ft
68.0ft	0.07 fc	158.0 ft	157.8 ft
85.0ft	0.04 fc	197.5 ft	197.3 ft
102.0ft	0.03 fc	237.0 ft	236.7 ft

■ Vert. Spread: 98.6°
■ Horiz. Spread: 98.5°

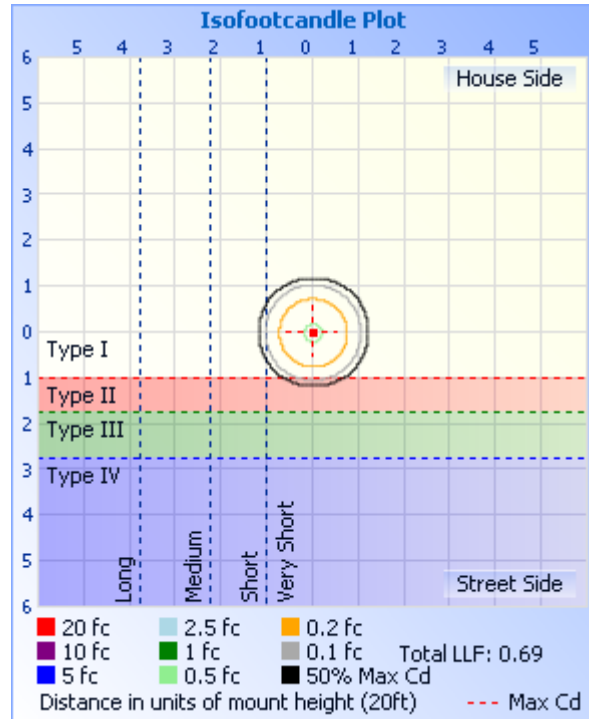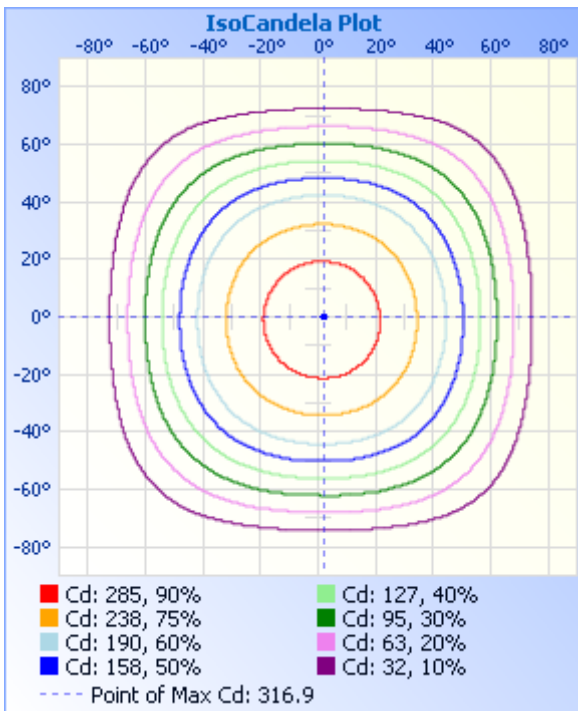

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

Candela Table - Type C

	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	360
0	316	316	316	316	316	316	316	316	316	316	316	316	316	316	316	316	316
1	316	316	316	316	317	316	316	316	316	316	317	317	317	317	316	316	316
2	316	316	316	316	316	316	316	316	316	316	317	317	317	316	316	316	316
3	315	315	315	316	316	316	316	316	316	316	316	317	317	316	316	315	315
4	315	314	314	315	315	315	315	315	315	316	316	316	316	316	315	315	315
5	314	314	314	314	314	314	314	314	315	315	316	316	316	315	315	314	314
6	313	313	312	313	313	313	313	314	314	315	315	315	315	314	314	313	313
7	312	311	311	311	312	312	313	313	313	314	314	314	314	313	313	312	312
8	310	310	310	310	310	311	311	311	312	313	313	313	313	312	312	311	310
9	309	309	308	309	309	310	310	310	311	312	312	312	312	311	310	310	309
10	307	307	307	307	307	308	308	309	309	310	311	311	311	310	309	308	307
11	306	305	305	305	305	306	307	307	308	309	309	309	309	308	307	307	306
12	304	303	303	303	303	304	305	305	306	307	307	308	308	306	305	305	304
13	302	301	301	301	301	302	303	303	305	305	306	306	306	304	304	302	302
14	300	299	299	299	299	300	301	302	302	304	304	304	303	302	301	301	300
15	297	297	296	296	297	297	298	299	300	301	302	302	302	300	299	298	297
16	295	294	294	294	294	295	296	297	298	299	300	299	299	298	297	296	295
17	292	291	291	291	292	293	293	295	295	297	297	297	297	296	294	293	292
18	290	289	288	289	289	290	291	292	293	294	295	295	294	293	292	291	290
19	287	286	285	286	287	287	288	289	290	292	292	292	292	290	290	288	287
20	284	283	283	283	283	284	285	286	287	289	290	289	289	287	287	285	284
21	281	280	279	280	280	281	282	283	285	286	287	287	286	284	283	282	281
22	278	277	277	276	277	278	279	280	282	283	284	284	283	282	281	279	278
23	274	274	273	273	273	275	276	277	279	280	281	281	280	278	277	276	274
24	271	270	270	270	270	272	273	274	275	277	277	277	277	275	274	272	271
25	268	267	266	266	266	268	270	270	272	273	274	274	273	271	271	269	268
26	264	263	263	262	262	265	266	267	269	270	270	271	270	268	267	266	264
27	260	260	259	259	259	261	261	264	265	266	267	267	266	264	264	262	260
28	256	256	255	255	255	257	259	259	261	262	263	264	263	261	259	258	256

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

29	253	251	252	251	251	253	254	256	257	259	260	260	259	257	256	254	253
30	248	248	247	247	247	249	251	252	254	255	256	256	254	253	252	251	248
31	245	243	244	242	243	245	247	248	249	252	252	252	251	249	248	246	245
32	240	240	239	239	238	241	243	244	245	247	248	247	246	245	244	243	240
33	236	235	235	234	235	236	239	239	241	243	244	244	243	241	240	238	236
34	231	231	231	230	230	232	234	236	237	239	240	239	238	236	236	234	231
35	227	226	227	225	226	228	230	231	233	234	236	235	233	232	232	229	227
36	222	222	222	221	221	224	226	227	228	230	231	230	229	227	227	225	222
37	217	217	217	216	216	218	222	222	223	225	227	226	224	224	223	220	217
38	213	213	213	212	211	213	217	217	218	220	222	222	220	218	218	215	213
39	207	208	208	207	207	209	212	213	213	216	218	216	215	213	213	211	207
40	203	202	204	201	202	203	208	208	209	211	213	211	209	209	209	205	203
41	198	198	199	197	196	200	203	203	204	206	208	207	205	203	204	201	198
42	194	193	194	192	192	194	198	198	198	201	204	202	200	199	200	196	194
43	188	188	189	188	186	189	193	193	194	196	199	197	196	194	194	191	188
44	182	183	184	182	182	185	187	188	189	192	194	192	190	190	190	186	182
45	178	178	179	178	176	179	183	183	184	186	189	187	184	184	184	180	178
46	172	173	173	172	172	175	177	179	179	182	183	182	180	179	179	176	172
47	168	167	169	166	166	169	172	173	173	176	179	177	174	174	174	170	168
48	162	163	163	161	161	164	167	167	169	170	173	172	170	168	168	166	162
49	157	157	158	157	156	159	162	163	163	166	167	167	164	164	164	160	157
50	151	152	153	151	150	153	158	158	157	160	163	161	158	158	158	156	151
51	146	147	147	146	145	148	151	153	152	155	157	156	154	154	153	150	146
52	141	142	143	141	140	143	146	147	147	150	152	151	148	148	148	144	141
53	135	136	137	136	135	138	141	142	142	144	147	146	142	142	142	139	135
54	130	131	132	131	129	133	135	137	136	140	141	140	137	138	137	134	130
55	125	126	126	125	125	127	131	131	130	134	136	134	132	132	132	129	125
56	119	120	122	120	119	121	125	125	126	128	130	130	127	127	127	123	119
57	114	115	116	114	113	117	119	120	120	124	126	124	121	121	121	118	114
58	108	110	110	110	108	111	115	115	115	118	120	118	115	116	115	113	108
59	103	104	105	104	103	106	109	110	109	113	114	113	111	111	110	107	103

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

60	98	99	100	99	98	101	103	105	104	107	109	108	105	105	105	102	98
61	93	93	95	93	92	95	98	99	99	102	104	103	99	100	100	96	93
62	87	89	89	88	86	90	93	94	93	97	98	97	94	94	94	91	87
63	81	83	85	83	82	85	88	88	87	91	93	91	88	90	89	85	81
64	77	78	79	77	76	80	83	84	83	85	87	86	84	84	84	80	77
65	71	72	73	73	71	74	77	78	77	81	83	81	78	79	78	75	71
66	66	66	69	67	66	68	72	71	72	75	77	76	72	73	73	69	66
67	60	62	63	62	61	64	67	67	66	70	71	70	68	67	67	65	60
68	56	56	59	56	55	58	61	62	61	64	67	64	62	62	63	59	56
69	50	52	53	51	50	52	57	56	56	58	61	60	57	57	57	54	50
70	45	46	48	46	45	48	51	51	50	54	57	54	52	52	53	48	45
71	40	40	43	41	40	42	47	46	46	48	51	48	46	47	47	43	40
72	35	36	38	37	36	38	41	41	41	44	46	44	41	41	42	39	35
73	31	31	34	31	31	33	36	36	35	38	41	38	36	37	38	33	31
74	26	27	29	27	26	28	32	31	31	33	36	34	31	31	32	29	26
75	22	23	25	23	22	24	27	27	26	29	31	29	27	27	28	25	22
76	19	19	20	18	18	20	23	22	22	24	27	24	23	23	23	21	19
77	15	15	16	15	15	16	19	19	18	20	22	20	19	18	20	17	15
78	12	12	13	12	12	13	14	15	15	16	18	16	15	15	16	13	12
79	9	9	10	10	10	10	12	11	12	13	14	14	12	12	12	10	9
80	7	7	8	7	7	8	9	9	9	10	11	10	10	10	9	8	7
81	5	5	6	5	5	6	7	6	6	7	8	8	8	7	7	6	5
82	3	4	4	4	4	4	5	5	4	5	6	6	6	6	5	4	3
83	3	3	3	3	3	3	4	3	3	4	5	5	4	4	4	3	3
84	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	2	2
85	2	2	2	2	2	2	2	2	2	2	3	3	3	3	2	2	2
86	1	1	1	1	2	2	2	2	1	2	2	2	2	2	1	1	1
87	0	0	1	1	1	1	1	1	1	1	1	2	2	1	1	1	0
88	0	0	0	0	0	1	0	0	0	1	1	1	1	1	0	0	0
89	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
90	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

91	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
92	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
93	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
94	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
95	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
96	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
97	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
98	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0
99	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
101	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
102	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
103	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
104	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
105	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
106	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
107	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
108	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
109	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
111	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
112	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
113	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
114	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
115	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
116	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
117	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
118	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
119	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
121	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

122	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
123	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
124	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
125	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
126	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
127	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
128	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
129	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
131	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
132	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
133	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
134	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
135	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
136	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
137	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
138	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
139	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
141	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
142	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
143	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
144	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
145	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
146	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
147	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
148	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
149	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
151	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
152	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

153	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
154	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
155	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
156	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
157	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
158	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
159	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

STANDARD-TECH



Report No.: GZE1612120-AN

NVLAP LAB CODE 201011-0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

3. Test Equipment

Equipment ID	Equipment Name	Last Calibration Date	Next Calibration Date
ST-R-336	2 meter Integrating Sphere	2016-07-01	2017-06-30
ST-R-331	Spectral analysis system HAAS-2000	2016-07-01	2017-06-30
D204	Standard Lamp	2016-07-01	2017-06-30
PF2010	Power Meter for Integrating Sphere	2016-07-01	2017-06-30
EE-09	Goniophotometer system	2016-07-01	2017-06-30
D908S	Standard Lamp	2016-07-01	2017-06-30
PF210	Power Meter for Goniophotometer	2016-07-01	2017-06-30
ST-R-181A	Temperature Tester	2016-07-01	2017-06-30
Uncertainty: Photometric Measurement (Sphere):1.74% Chromaticity Measurement(Sphere):14.3K Photometric Measurement(Goniophotometer):1.62%			

******* END OF REPORT *******

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>