

LM-79-08 Test Report

For

L-TECH CORPORTION (Brand Name: L-TECH CORP)

SHAOGANGTOU DISTRICT.QIAOTOU TOWN.DONGGUAN
CITY.GUANGDONG PROVINCE,CHINA

LED Luminare

Model name(s): LRKT449W-EN-3090

Representative (Tested) Model: LRKT449W-EN-3090

Model Different: N/A

Test & Report By:

Univ Xie

Engineer: Univ Xie

Date: Jan17, 2017

Review By:

Tommy Liang

Manager: Tommy Liang

Note: This report does not imply product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government.

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2


Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

1.1 Product Information:

Organization Name	L-TECH CORPORTION	
Brand Name	L-TECH CORP	
Model Number	LRKT449W-EN-3090	
SKU (if available)	N/A	
Type of Luminaire (for integral lamps, list base type and lamp type)	LED Luminaire	
Rated Voltage / Frequency	120Vac, 60 Hz	
Nominal Power	11W	
Rated Initial Lamp Lumen	--	
Declared CCT	3000K	
LED Manufacturer	Edison Opto Corporation	
LED Model	2T03X5	
Sample Number	GZE1612120-AP1	
Luminaire Aperture (for downlights)	--	in.
Luminaire Length	--	mm
Luminaires Width	--	mm
Number of Units (modular products)	N/A	s

Photo

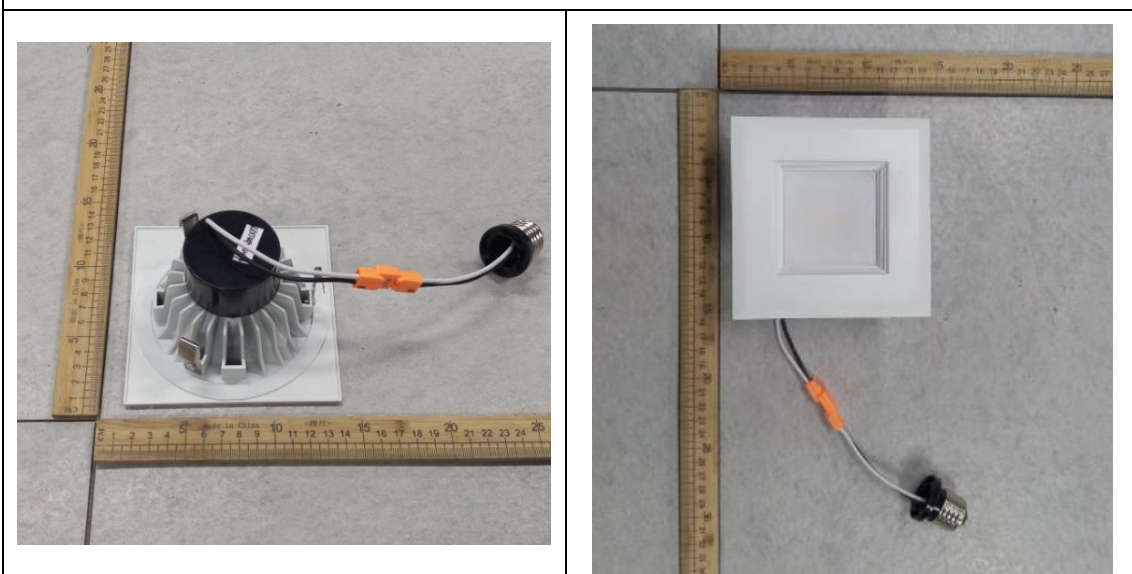

1.2 Test Specifications:

Date of Receipt	Jan08, 2017
Date of Test	Jan.11, 2017
Test item	<ol style="list-style-type: none"> 1. Total Luminous Flux 2. Luminous Distribution Intensity 3. Luminous Efficacy 4. Correlated Color Temperature 5. Color Rendering Index 6. Chromaticity Coordinate 7. Electrical Parameters
Reference Standard	<ol style="list-style-type: none"> 1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products 2. ANSI C78.377-2008 Specifications for the Chromaticity of Solid State Lighting Products 3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources 4. CIE 15-2004 Technical Report Colorimetry 5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source 6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems
Reference Work Instruction	QD25

1.3 Test Methods

<p>1) Photometric and Light Distribution Measurement – Goniophotometer Method: Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals.</p>
<p>2) Chromaticity Measurement – Sphere-Spectroradiometer Method: Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25° C ± 1° C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.</p>
<p>3) Electrical Measurements: Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25° C ± 1° C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.</p>

2.1 Electrical, Photometric and Chromaticity Measurements

(Refer to Work Instruction QD25)

Test date	2017-01-11	Test Ambient:	25.2 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	LRKT449W-EN-3090		

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
GZE161212 0-AP1	120.0	60	0.0940	10.59	0.9397


Chromaticity Measurement - Sphere-Spectroradiometer Method:

Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120.0	R1	93	R9	54
Frequency (Hz)	60	R2	97	R10	93
CCT (K)	3082	R3	98	R11	93
Duv	-0.0005	R4	92	R12	81
Chromaticity (x, y)	x=0.4305 y=0.4004	R5	92	R13	94
Chromaticity (u', v')	u'=0.2480 v'=0.5190	R6	96	R14	100
Color Rendering Index (CRI)	92.2	R7	90	R15	88
R9	54	R8	79	--	--

Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	707.16
Luminous Efficacy (lm/W)	66.78
Beam Angle (°)	98.8
Center Beam Candle Power (cd)	298

Spectral Power Distribution & Chromaticity Diagram

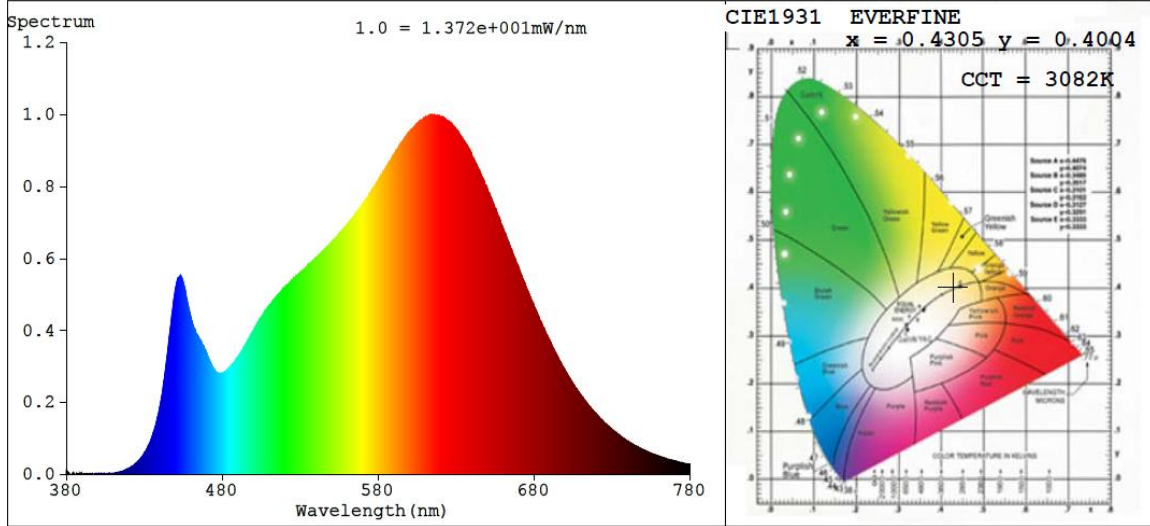


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	224.4	31.7%
0-40	359.8	50.9%
0-60	602.6	85.2%
60-90	103.6	14.6%
70-100	31.5	4.5%
90-120	0.3	0%
0-90	706.2	99.9%
90-180	0.9	0.1%
0-180	707.1	100%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	28.1	4.0%	90-100	0.1	0%
10-20	79.4	11.2%	100-110	0.1	0%
20-30	116.9	16.5%	110-120	0.1	0%
30-40	135.3	19.1%	120-130	0.1	0%
40-50	132.7	18.8%	130-140	0.1	0%
50-60	110.1	15.6%	140-150	0.1	0%
60-70	72.2	10.2%	150-160	0.1	0%
70-80	28.0	4.0%	160-170	0.1	0%
80-90	3.4	0.5%	170-180	0.0	0%



Photometric Data

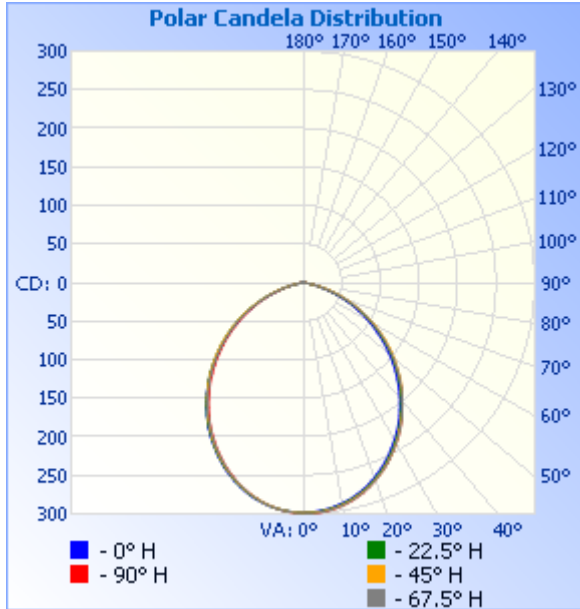

Illuminance at a Distance

	Center Beam fc	Beam Width	
17.0ft	1.03 fc	39.6 ft	39.6 ft
34.0ft	0.26 fc	79.2 ft	79.2 ft
51.0ft	0.11 fc	118.8 ft	118.9 ft
68.0ft	0.06 fc	158.4 ft	158.5 ft
85.0ft	0.04 fc	198.0 ft	198.1 ft
102.0ft	0.03 fc	237.6 ft	237.7 ft

■ Vert. Spread: 98.7°
■ Horiz. Spread: 98.7°

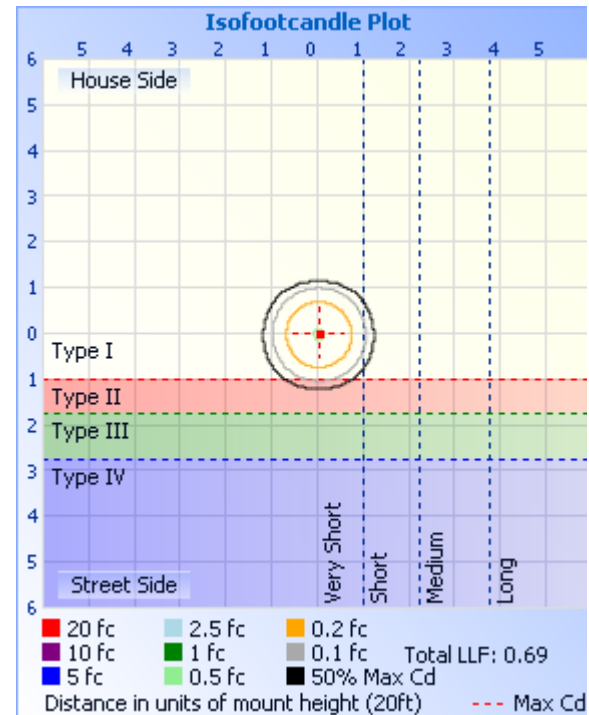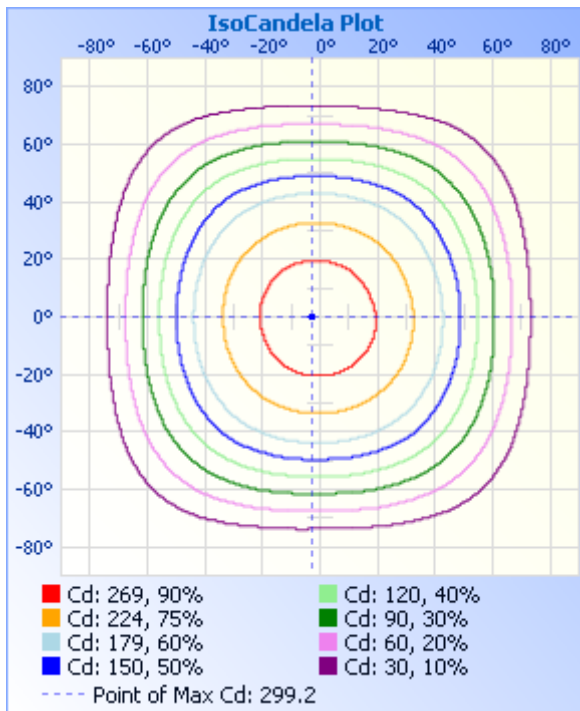

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

Candela Table - Type C

	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	360
0	298	298	298	298	298	298	298	298	298	298	298	298	298	298	298	298	298
1	298	298	299	299	299	298	298	298	298	298	298	299	299	297	297	298	298
2	298	298	299	299	299	298	298	298	298	298	298	298	299	297	297	297	298
3	297	298	298	299	299	297	297	297	297	297	298	298	298	296	296	297	297
4	297	297	298	299	299	297	297	297	297	297	297	297	297	296	296	296	297
5	296	297	298	298	298	297	296	296	296	296	296	296	296	295	295	295	296
6	295	296	297	297	298	296	296	296	296	295	295	295	296	294	294	295	295
7	294	295	296	297	297	295	295	295	295	294	294	294	294	292	293	293	294
8	293	294	295	295	296	294	294	294	294	293	293	293	293	291	291	292	293
9	292	293	294	295	295	293	293	293	292	292	291	292	292	290	290	291	292
10	290	292	293	293	293	292	292	291	291	291	290	290	290	288	289	289	290
11	289	290	291	292	292	290	291	290	289	289	288	289	288	287	287	288	289
12	287	288	289	290	291	289	289	288	288	287	286	287	286	284	285	286	287
13	285	287	288	289	289	287	287	287	286	285	285	284	284	282	283	284	285
14	283	285	286	287	287	286	285	285	284	283	283	283	282	280	281	282	283
15	282	283	284	285	285	284	283	283	282	281	281	280	280	278	279	280	282
16	279	281	282	283	283	281	281	280	280	279	278	278	278	276	276	277	279
17	277	279	280	280	281	279	279	278	277	276	275	275	275	273	274	275	277
18	274	276	278	278	278	277	277	276	275	274	273	273	273	271	271	273	274
19	271	273	275	276	276	274	274	274	272	271	270	270	270	268	269	270	271
20	269	271	273	273	273	272	271	271	269	268	268	267	267	265	266	267	269
21	266	268	270	270	270	269	269	268	267	266	265	264	264	262	264	265	266
22	263	265	267	267	267	266	266	265	264	263	262	261	260	259	261	262	263
23	260	262	264	264	265	263	263	262	261	260	259	258	258	256	257	258	260
24	257	259	261	261	261	260	261	259	257	256	255	255	254	252	254	255	257
25	253	256	258	258	258	257	257	255	254	253	252	251	250	249	250	252	253
26	251	252	254	255	255	253	253	252	251	250	249	248	247	246	248	249	251
27	247	249	251	251	251	250	250	249	247	246	245	244	243	242	244	245	247
28	243	245	247	248	248	247	246	245	243	243	242	240	240	239	241	242	243

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

29	240	242	244	244	244	243	243	242	240	239	238	237	236	235	236	238	240
30	236	238	240	241	241	239	239	238	236	236	234	233	232	231	232	234	236
31	232	235	237	237	237	235	235	234	233	232	230	230	229	227	229	231	232
32	228	231	233	233	233	232	232	230	228	227	226	225	224	223	225	226	228
33	225	228	228	229	229	228	227	226	225	224	223	221	221	219	221	223	225
34	220	223	225	226	225	224	224	223	221	220	218	218	216	215	217	219	220
35	217	219	220	221	221	219	220	218	216	216	215	213	212	211	213	215	217
36	212	215	217	218	217	216	215	214	212	212	210	209	208	207	209	210	212
37	207	211	212	213	212	212	212	210	207	207	206	205	203	203	205	206	207
38	203	207	209	208	209	207	207	205	204	203	202	200	199	198	201	202	203
39	199	202	204	205	204	204	203	201	199	198	197	196	194	194	196	197	199
40	195	198	199	200	199	199	199	197	194	194	194	191	190	189	192	193	195
41	190	193	195	196	195	194	194	192	190	190	189	187	186	185	187	188	190
42	186	188	191	191	190	190	190	188	185	185	184	182	181	181	184	185	186
43	181	184	187	187	186	185	185	183	181	181	180	177	177	176	179	180	181
44	175	179	182	182	181	181	181	179	176	176	175	173	171	172	175	175	175
45	171	175	178	177	176	176	177	174	170	171	171	168	166	167	170	171	171
46	166	170	173	172	171	171	172	169	166	166	166	164	162	162	165	165	166
47	162	166	168	167	166	167	168	165	161	161	161	159	156	157	161	161	162
48	156	161	164	163	161	162	162	159	155	157	157	153	152	152	156	155	156
49	152	155	159	158	156	157	159	155	151	151	152	149	146	148	152	152	152
50	146	151	155	153	151	152	153	149	145	146	148	144	141	142	146	146	146
51	141	146	149	148	146	147	148	144	141	142	142	138	137	138	141	141	141
52	137	141	145	142	142	143	144	140	136	136	137	134	131	133	137	137	137
53	131	136	140	138	136	137	139	134	131	132	133	129	127	127	132	131	131
54	127	130	134	132	131	132	134	128	126	127	127	124	121	123	128	127	127
55	121	126	130	128	126	127	128	124	120	121	123	119	116	118	122	121	121
56	116	121	124	123	121	122	123	119	116	117	117	114	112	113	118	117	116
57	111	116	120	118	116	118	119	115	110	112	112	109	106	108	112	112	111
58	106	111	115	113	111	113	113	109	105	107	107	104	101	104	107	106	106
59	101	106	110	107	106	107	107	104	100	102	102	99	96	99	102	102	101

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

60	96	101	104	103	101	103	103	99	95	96	96	94	91	93	97	97	96
61	91	95	99	98	95	97	97	94	89	92	92	89	87	89	93	92	91
62	86	91	94	93	91	91	93	90	85	86	87	84	81	83	87	87	86
63	80	85	89	88	85	87	88	84	79	81	82	79	76	79	83	83	80
64	76	81	85	83	81	82	82	79	75	77	77	73	71	74	77	77	76
65	70	75	79	78	75	77	78	74	69	71	71	69	66	69	72	72	70
66	66	71	74	72	71	72	72	69	64	67	67	64	62	64	68	67	66
67	61	66	69	68	65	66	67	64	60	61	62	59	56	59	62	62	61
68	56	60	64	62	60	62	63	59	54	56	56	54	51	55	58	58	56
69	51	56	59	58	55	56	57	53	50	52	52	49	47	49	53	52	51
70	46	50	54	52	50	52	53	49	45	46	47	45	42	45	48	47	46
71	42	46	50	47	46	47	48	44	40	41	43	40	37	40	44	43	42
72	37	41	45	43	40	41	42	38	36	37	38	35	33	35	38	38	37
73	33	36	39	38	35	37	38	34	30	32	33	31	29	31	34	34	33
74	28	32	35	34	31	32	33	30	27	29	29	26	25	27	30	29	28
75	24	27	30	29	27	28	29	26	23	24	24	23	21	23	26	25	24
76	21	24	26	25	23	24	25	22	19	20	21	19	18	19	22	21	21
77	17	19	22	21	19	20	20	17	16	16	17	16	15	16	17	17	17
78	14	16	18	17	17	17	17	14	12	13	13	13	12	13	15	15	14
79	11	13	15	14	13	13	13	11	9	11	11	10	10	10	12	11	11
80	9	10	11	11	11	11	11	9	8	8	8	9	8	9	9	9	9
81	7	8	9	9	9	9	8	6	5	6	7	7	6	6	7	7	7
82	5	6	7	7	7	7	6	5	4	4	5	5	5	6	5	5	5
83	4	5	5	5	5	5	5	4	3	3	4	4	4	4	4	4	4
84	3	3	4	4	4	4	3	3	2	3	3	3	3	3	3	3	3
85	2	2	3	3	3	3	3	2	2	2	2	3	3	3	2	2	2
86	2	2	2	2	2	2	2	1	1	2	1	2	2	2	1	2	2
87	1	1	1	2	2	2	1	1	1	1	1	1	1	1	1	1	1
88	0	1	1	1	1	1	1	0	0	0	0	1	1	0	0	0	0
89	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
90	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

91	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
92	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
93	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
94	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
95	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
96	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
97	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
98	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
99	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
101	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0
102	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0
103	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
104	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0
105	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
106	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
107	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
108	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
109	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
111	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
112	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
113	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
114	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
115	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
116	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
117	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
118	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
119	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
121	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

122	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
123	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0
124	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
125	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
126	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0
127	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
128	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
129	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
130	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
131	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
132	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
133	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
134	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0
135	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0
136	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
137	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
138	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
139	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
141	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0
142	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
143	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
144	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
145	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
146	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
147	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
148	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
149	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
151	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
152	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

153	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
154	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
155	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
156	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0
157	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
158	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
159	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	1	0	0	0	0	0	1	1	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

STANDARD-TECH



Report No.: GZE1612120-AP

NVLAP LAB CODE 201011-0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

3. Test Equipment

Equipment ID	Equipment Name	Last Calibration Date	Next Calibration Date
ST-R-336	2 meter Integrating Sphere	2016-07-01	2017-06-30
ST-R-331	Spectral analysis system HAAS-2000	2016-07-01	2017-06-30
D204	Standard Lamp	2016-07-01	2017-06-30
PF2010	Power Meter for Integrating Sphere	2016-07-01	2017-06-30
EE-09	Goniophotometer system	2016-07-01	2017-06-30
D908S	Standard Lamp	2016-07-01	2017-06-30
PF210	Power Meter for Goniophotometer	2016-07-01	2017-06-30
ST-R-181A	Temperature Tester	2016-07-01	2017-06-30
Uncertainty: Photometric Measurement (Sphere):1.74% Chromaticity Measurement(Sphere):14.3K Photometric Measurement(Goniophotometer):1.62%			

******* END OF REPORT *******

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>