

## LM-79-08 Test Report

For

**L-TECH CORPORTION**

**(Brand Name: L-TECH CORP)**

SHAOGANGTOU DISTRICT.QIAOTOU TOWN.DONGGUAN  
CITY.GUANGDONG PROVINCE,CHINA

### LED Luminare

Model name(s): LRKT643W-EN-2790

Representative (Tested) Model: LRKT643W-EN-2790

Model Different: N/A

Test & Report By:

*Univ Xie*

Engineer: Univ Xie

Date: Jan17, 2017

Review By:

*Tommy Liang*

Manager: Tommy Liang

Note: This report does not imply product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government.

**Laboratory: Standard-Tech Co. Ltd Testing Center**  
**NVLAP CODE: 201011-0**

Report Format Number STD/QR4909-A/2


Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

**1.1 Product Information:**

Organization Name	L-TECH CORPORTION	
Brand Name	L-TECH CORP	
Model Number	LRKT643W-EN-2790	
SKU (if available)	N/A	
Type of Luminaire (for integral lamps, list base type and lamp type)	LED Luminaire	
Rated Voltage / Frequency	120Vac, 60 Hz	
Nominal Power	15W	
Rated Initial Lamp Lumen	--	
Declared CCT	2700K	
LED Manufacturer	Edison Opto Corporation	
LED Model	2T03X5	
Sample Number	GZE1612120-BA1	
Luminaire Aperture (for downlights)	--	in.
Luminaire Length	--	mm
Luminaires Width	--	mm
Number of Units (modular products)	N/A	s

**Photo**

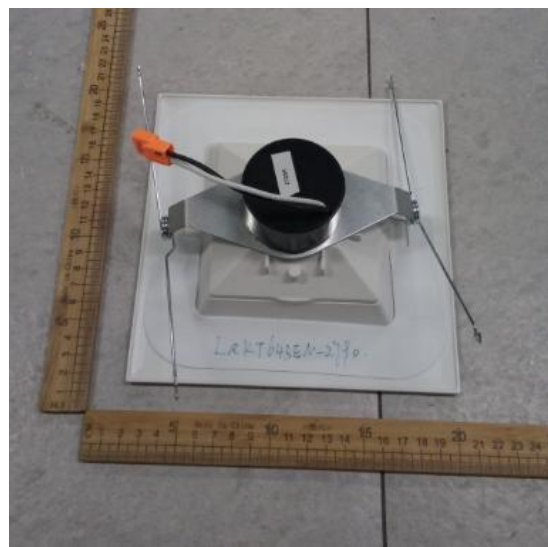

**1.2 Test Specifications:**

Date of Receipt	Jan08, 2017
Date of Test	Jan.11, 2017
Test item	<ol style="list-style-type: none"> <li>1. Total Luminous Flux</li> <li>2. Luminous Distribution Intensity</li> <li>3. Luminous Efficacy</li> <li>4. Correlated Color Temperature</li> <li>5. Color Rendering Index</li> <li>6. Chromaticity Coordinate</li> <li>7. Electrical Parameters</li> </ol>
Reference Standard	<ol style="list-style-type: none"> <li>1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products</li> <li>2. ANSI C78.377-2008 Specifications for the Chromaticity of Solid State Lighting Products</li> <li>3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources</li> <li>4. CIE 15-2004 Technical Report Colorimetry</li> <li>5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source</li> <li>6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems</li> </ol>
Reference Work Instruction	QD25

**1.3 Test Methods**

<p><b>1) Photometric and Light Distribution Measurement – Goniophotometer Method:</b></p> <p>Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals.</p>
<p><b>2) Chromaticity Measurement – Sphere-Spectroradiometer Method:</b></p> <p>Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25° C ± 1° C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.</p>
<p><b>3) Electrical Measurements:</b></p> <p>Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25° C ± 1° C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.</p>

**2.1 Electrical, Photometric and Chromaticity Measurements**

*(Refer to Work Instruction QD25)*

<b>Test date</b>	2017-01-11	<b>Test Ambient:</b>	25.2 °C
<b>Test Orientation</b>	As intended	<b>Stabilization Time (min)</b>	90
<b>Model Number</b>	LRKT643W-EN-2790		

**Electrical Measurement:**

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
GZE161212 0-BA1	120.0	60	0.1250	14.45	0.9615


**Chromaticity Measurement - Sphere-Spectroradiometer Method:**

Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120.0	R1	93	R9	56
Frequency (Hz)	60	R2	97	R10	93
CCT (K)	2748	R3	98	R11	94
Duv	-0.0011	R4	93	R12	87
Chromaticity (x, y)	x=0.4541 y=0.4062	R5	93	R13	94
Chromaticity (u', v')	u'=0.2607 v'=0.5248	R6	97	R14	100
Color Rendering Index (CRI)	92.7	R7	90	R15	88
R9	56	R8	79	--	--

**Photometric Measurement – Goniophotometer Method:**

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	1008.3
Luminous Efficacy (lm/W)	69.78
Beam Angle (°)	100.2
Center Beam Candle Power (cd)	422

**Spectral Power Distribution & Chromaticity Diagram**

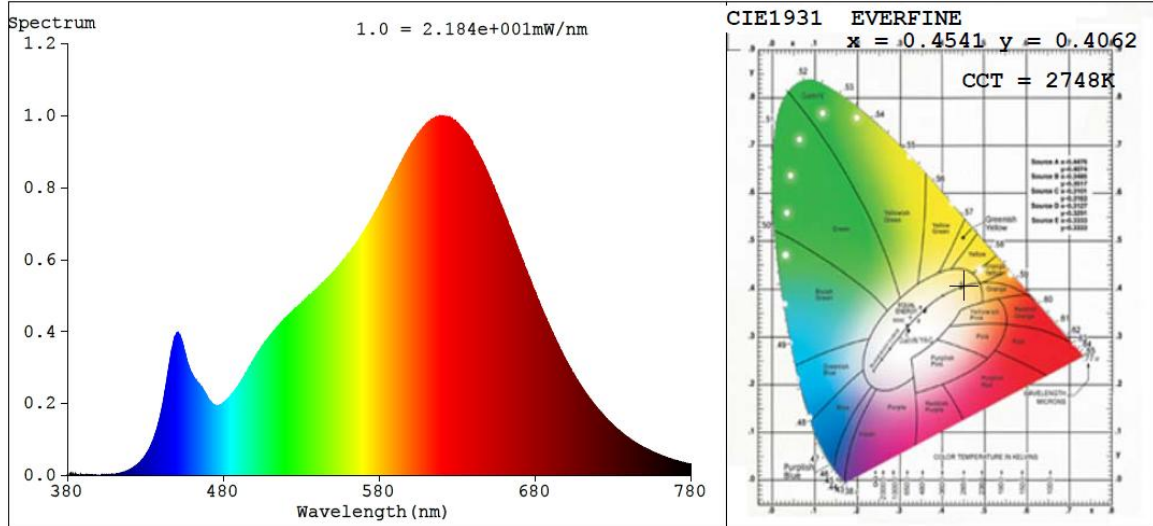


**Zonal Lumen Tabulation**

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	320.2	31.8%
0-40	514.6	51%
0-60	865.8	85.9%
60-90	141.3	14%
70-100	38.4	3.8%
90-120	0.3	0%
0-90	1,007.2	99.9%
90-180	1.0	0.1%
0-180	1,008.1	100%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	39.8	4.0%	90-100	0.1	0%
10-20	112.9	11.2%	100-110	0.1	0%
20-30	167.4	16.6%	110-120	0.1	0%
30-40	194.4	19.3%	120-130	0.1	0%
40-50	191.3	19.0%	130-140	0.1	0%
50-60	160.0	15.9%	140-150	0.1	0%
60-70	103.0	10.2%	150-160	0.1	0%
70-80	33.7	3.3%	160-170	0.1	0%
80-90	4.6	0.5%	170-180	0.0	0%



**Photometric Data**

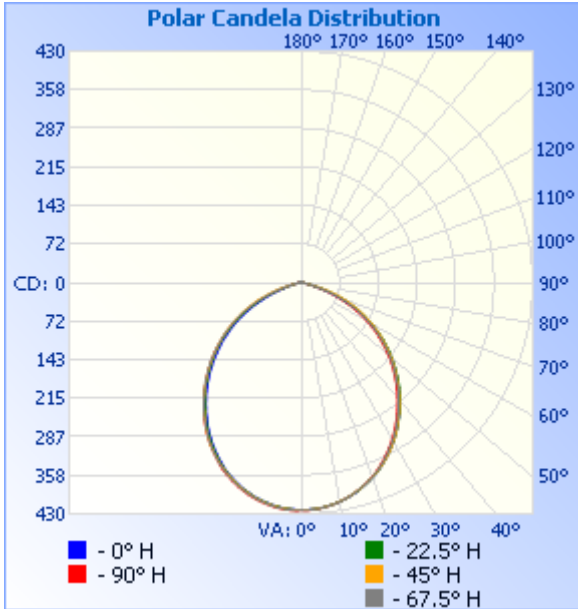

**Illuminance at a Distance**

	Center Beam fc	Beam Width	
17.0ft	<b>1.46 fc</b>	<b>40.7 ft</b>	<b>40.7 ft</b>
34.0ft	<b>0.37 fc</b>	<b>81.3 ft</b>	<b>81.4 ft</b>
51.0ft	<b>0.16 fc</b>	<b>122.0 ft</b>	<b>122.1 ft</b>
68.0ft	<b>0.09 fc</b>	<b>162.7 ft</b>	<b>162.8 ft</b>
85.0ft	<b>0.06 fc</b>	<b>203.3 ft</b>	<b>203.5 ft</b>
102.0ft	<b>0.04 fc</b>	<b>244.0 ft</b>	<b>244.2 ft</b>

■ Vert. Spread: 100.2°  
■ Horiz. Spread: 100.2°

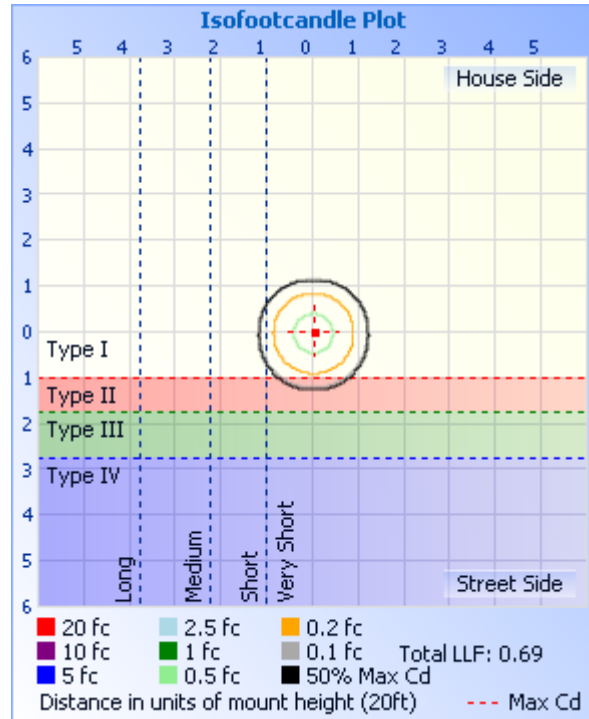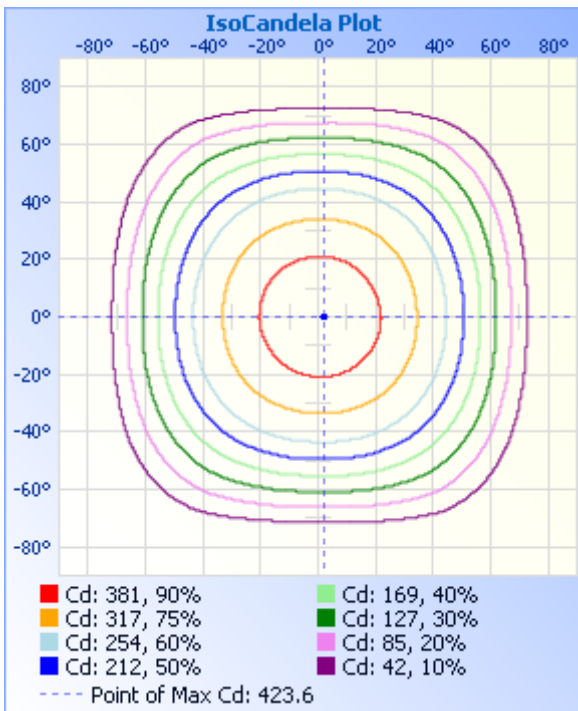

Laboratory: Standard-Tech Co. Ltd Testing Center  
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

**Candela Table - Type C**

	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	360
0	422	422	422	422	422	422	422	422	422	422	422	422	422	422	422	422	422
1	422	422	422	423	423	421	421	421	422	422	422	423	424	421	421	421	422
2	422	422	422	423	423	421	421	421	421	422	422	423	423	421	421	421	422
3	421	422	422	422	422	420	420	420	421	421	421	423	423	421	421	421	421
4	421	421	421	421	422	419	419	419	420	421	421	422	422	420	420	420	421
5	420	420	420	421	421	419	419	419	419	420	420	421	422	419	419	420	420
6	419	419	419	420	420	417	417	417	418	418	419	420	421	418	418	419	419
7	418	418	418	418	418	416	416	416	417	417	418	419	419	417	417	417	418
8	417	416	416	417	417	415	414	415	415	416	416	417	418	416	416	416	417
9	415	415	415	415	415	413	412	413	413	414	415	416	416	414	414	415	415
10	413	413	413	413	413	411	411	411	412	412	413	414	415	412	413	413	413
11	411	411	411	411	411	409	409	409	410	410	410	412	412	410	411	411	411
12	409	409	409	409	409	406	406	406	408	408	409	410	410	408	409	409	409
13	407	407	407	406	406	404	404	404	405	405	406	407	408	406	406	407	407
14	404	404	404	404	403	401	401	401	402	403	403	405	406	403	404	404	404
15	402	402	401	401	401	398	398	399	399	400	401	402	403	401	401	402	402
16	399	399	398	398	398	396	395	395	396	397	398	399	400	398	398	399	399
17	395	395	395	395	394	392	392	392	393	394	395	396	397	395	395	395	395
18	393	393	392	392	391	389	389	389	390	390	391	392	394	392	392	392	393
19	389	389	389	388	388	386	385	385	386	387	387	389	390	389	389	389	389
20	386	386	385	385	384	382	382	382	383	383	384	385	387	385	386	386	386
21	382	382	382	381	380	378	378	378	378	379	380	382	383	382	382	382	382
22	379	378	378	377	376	374	374	373	375	376	377	378	379	378	378	379	379
23	374	374	374	373	372	370	370	370	370	371	372	374	375	373	374	375	374
24	370	370	370	368	367	366	366	365	365	367	369	370	371	369	371	371	370
25	366	366	366	364	363	361	362	361	361	362	364	365	365	364	366	366	366
26	361	361	362	359	357	356	357	356	355	357	359	361	361	360	362	362	361
27	356	356	357	354	353	352	353	351	351	353	355	355	356	355	357	357	356
28	352	351	352	349	347	347	348	346	345	347	350	351	351	351	353	352	352

Laboratory: Standard-Tech Co. Ltd Testing Center  
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

29	346	347	347	344	342	341	343	341	340	342	346	345	345	345	348	347	346
30	342	341	342	338	337	336	337	335	334	337	340	340	341	341	344	343	342
31	336	337	337	334	332	330	331	329	330	332	335	334	335	335	338	337	336
32	331	331	331	328	326	326	326	324	323	326	329	328	330	330	333	332	331
33	325	326	326	323	320	320	320	318	318	321	324	323	324	324	327	326	325
34	320	320	319	316	314	314	315	313	312	314	317	317	318	319	322	321	320
35	314	315	314	311	309	308	308	306	305	308	311	312	312	312	316	315	314
36	309	308	308	305	302	303	303	301	299	302	306	305	305	307	310	310	309
37	302	303	302	300	297	296	296	294	293	296	299	300	300	301	304	304	302
38	296	297	296	293	290	290	289	288	287	290	293	293	293	295	298	299	296
39	290	291	290	288	285	284	284	281	280	283	286	288	287	288	292	292	290
40	284	285	284	281	278	277	277	274	274	278	281	281	280	283	286	285	284
41	278	279	278	275	272	272	271	269	267	271	274	274	275	276	279	280	278
42	271	272	271	269	265	265	264	262	260	265	268	268	268	269	272	273	271
43	266	267	265	263	259	260	258	256	254	258	261	261	261	263	267	268	266
44	259	260	258	255	252	253	251	249	247	251	254	256	255	256	260	261	259
45	253	254	251	248	246	245	244	243	241	245	248	248	247	251	254	255	253
46	246	247	246	242	239	240	238	236	233	238	240	241	242	243	247	248	246
47	239	240	238	235	233	232	231	228	226	230	235	235	234	238	241	242	239
48	233	234	233	229	226	226	225	222	220	224	227	228	227	230	234	235	233
49	225	227	225	222	220	219	218	215	212	217	220	222	220	224	227	228	225
50	219	221	220	216	212	212	210	207	204	211	214	214	213	217	221	222	219
51	212	213	212	208	204	206	204	201	198	203	206	207	207	209	213	215	212
52	206	207	205	201	198	198	197	193	190	195	199	201	199	203	207	209	206
53	198	200	199	195	191	190	189	187	184	189	193	193	191	195	200	201	198
54	191	192	191	187	184	184	183	179	176	181	185	185	185	189	194	193	191
55	184	186	185	181	176	177	176	171	167	175	179	179	177	181	187	187	184
56	177	178	178	173	170	170	170	165	161	167	172	171	169	175	179	180	177
57	170	172	172	166	162	163	162	157	153	159	164	165	163	167	173	173	170
58	162	164	164	159	154	155	155	149	146	152	158	157	154	159	165	165	162
59	156	156	158	151	147	149	148	142	138	144	150	149	148	153	159	159	156

Laboratory: Standard-Tech Co. Ltd Testing Center  
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>



60	148	150	151	144	139	141	141	134	129	136	144	142	139	144	152	151	148
61	139	142	143	136	132	134	135	127	122	130	136	134	131	138	146	145	139
62	133	136	137	129	124	126	127	119	113	121	129	127	124	130	138	137	133
63	124	127	129	121	115	118	119	110	106	114	122	119	115	121	130	128	124
64	117	121	123	114	108	111	113	103	97	106	115	110	108	114	124	121	117
65	108	112	115	105	99	103	105	94	88	97	107	103	99	106	116	113	108
66	101	104	107	96	92	96	99	87	81	90	100	95	90	99	110	106	101
67	92	97	100	90	82	87	90	78	72	81	92	88	83	90	102	98	92
68	82	88	92	80	73	79	82	69	63	74	86	79	74	83	93	89	82
69	75	81	85	73	66	72	76	62	56	65	77	70	65	74	87	82	75
70	65	72	77	64	57	63	67	54	48	57	69	63	58	65	78	72	65
71	58	64	70	57	50	54	59	46	42	50	62	55	50	58	72	65	58
72	49	55	61	48	42	47	52	40	35	42	54	47	44	50	63	56	49
73	41	46	52	40	36	39	43	33	29	35	47	41	37	44	56	49	41
74	34	39	45	34	29	33	37	28	25	30	39	33	30	36	47	40	34
75	28	32	37	28	24	27	29	23	21	24	31	28	26	31	39	32	28
76	23	26	30	23	20	22	23	19	18	21	26	23	22	25	32	27	23
77	19	21	23	19	17	18	18	16	15	17	20	19	19	20	25	22	19
78	16	17	17	15	14	15	14	13	13	14	16	16	15	17	20	18	16
79	14	14	14	13	12	12	12	12	11	12	13	13	13	14	15	15	14
80	11	12	11	11	10	10	10	10	9	10	10	11	11	12	13	12	11
81	9	10	10	9	8	8	8	8	8	9	9	9	9	10	10	10	9
82	8	8	8	8	7	7	7	7	7	7	7	8	8	8	8	8	8
83	7	7	7	6	6	6	6	6	6	6	6	7	7	7	7	7	7
84	5	5	5	5	5	5	5	5	5	5	5	6	6	6	6	5	5
85	3	3	3	4	4	4	3	3	3	4	4	5	5	5	4	4	3
86	2	2	2	3	2	2	2	2	2	3	3	4	4	4	3	2	2
87	1	1	1	1	1	1	1	1	1	1	2	2	2	2	2	1	1
88	0	0	0	0	0	1	0	0	0	1	1	1	2	1	1	0	0
89	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
90	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center  
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

91	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
92	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
93	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
94	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
95	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
96	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
97	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
98	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
99	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
101	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
102	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
103	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
104	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
105	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
106	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
107	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
108	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
109	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
111	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
112	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
113	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
114	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
115	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
116	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
117	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
118	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
119	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
121	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center  
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

122	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
123	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
124	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
125	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
126	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
127	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
128	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
129	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
131	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
132	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
133	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
134	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
135	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
136	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
137	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
138	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
139	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
141	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
142	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
143	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
144	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
145	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
146	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
147	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
148	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
149	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
151	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
152	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center  
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

153	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
154	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
155	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
156	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
157	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
158	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
159	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center  
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

**STANDARD-TECH**



Report No.: GZE1612120-BA

NVLAP LAB CODE 201011-0

**Laboratory: Standard-Tech Co. Ltd Testing Center**  
**NVLAP CODE: 201011-0**

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

**3. Test Equipment**

Equipment ID	Equipment Name	Last Calibration Date	Next Calibration Date
ST-R-336	2 meter Integrating Sphere	2016-07-01	2017-06-30
ST-R-331	Spectral analysis system HAAS-2000	2016-07-01	2017-06-30
D204	Standard Lamp	2016-07-01	2017-06-30
PF2010	Power Meter for Integrating Sphere	2016-07-01	2017-06-30
EE-09	Goniophotometer system	2016-07-01	2017-06-30
D908S	Standard Lamp	2016-07-01	2017-06-30
PF210	Power Meter for Goniophotometer	2016-07-01	2017-06-30
ST-R-181A	Temperature Tester	2016-07-01	2017-06-30
Uncertainty: Photometric Measurement (Sphere):1.74% Chromaticity Measurement(Sphere):14.3K Photometric Measurement(Goniophotometer):1.62%			

**\*\*\*\*\* END OF REPORT \*\*\*\*\***

**Laboratory: Standard-Tech Co. Ltd Testing Center**  
**NVLAP CODE: 201011-0**

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>