

LM-79-08 Test Report

For

L-TECH CORPORTION

(Brand Name: L-TECH CORP)

SHAOGANGTOU DISTRICT.QIAOTOU TOWN.DONGGUAN
CITY.GUANGDONG PROVINCE,CHINA

LED Luminare

Model name(s): LRKT643W-EN-3090

Representative (Tested) Model: LRKT643W-EN-3090

Model Different: N/A

Test & Report By:

Univ Xie

Engineer: Univ Xie

Date: Jan17, 2017

Review By:

Tommy Liang

Manager: Tommy Liang

Note: This report does not imply product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government.

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2


Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

1.1 Product Information:

Organization Name	L-TECH CORPORTION	
Brand Name	L-TECH CORP	
Model Number	LRKT643W-EN-3090	
SKU (if available)	N/A	
Type of Luminaire (for integral lamps, list base type and lamp type)	LED Luminaire	
Rated Voltage / Frequency	120Vac, 60 Hz	
Nominal Power	15W	
Rated Initial Lamp Lumen	--	
Declared CCT	3000K	
LED Manufacturer	Edison Opto Corporation	
LED Model	2T03X5	
Sample Number	GZE1612120-BB1	
Luminaire Aperture (for downlights)	--	in.
Luminaire Length	--	mm
Luminaires Width	--	mm
Number of Units (modular products)	N/A	s

Photo

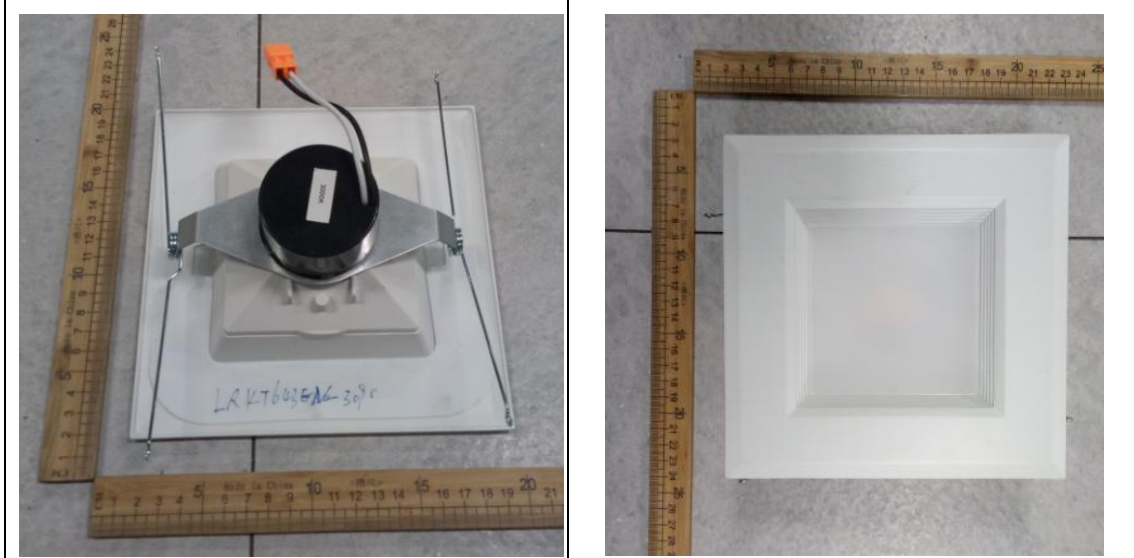

1.2 Test Specifications:

Date of Receipt	Jan08, 2017
Date of Test	Jan.11, 2017
Test item	<ol style="list-style-type: none"> 1. Total Luminous Flux 2. Luminous Distribution Intensity 3. Luminous Efficacy 4. Correlated Color Temperature 5. Color Rendering Index 6. Chromaticity Coordinate 7. Electrical Parameters
Reference Standard	<ol style="list-style-type: none"> 1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products 2. ANSI C78.377-2008 Specifications for the Chromaticity of Solid State Lighting Products 3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources 4. CIE 15-2004 Technical Report Colorimetry 5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source 6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems
Reference Work Instruction	QD25

1.3 Test Methods

<p>1) Photometric and Light Distribution Measurement – Goniophotometer Method:</p> <p>Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1° vertical intervals and 22.5° horizontal intervals.</p>
<p>2) Chromaticity Measurement – Sphere-Spectroradiometer Method:</p> <p>Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25° C ± 1° C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.</p>
<p>3) Electrical Measurements:</p> <p>Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25° C ± 1° C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.</p>

2.1 Electrical, Photometric and Chromaticity Measurements

(Refer to Work Instruction QD25)

Test date	2017-01-11	Test Ambient:	25.2 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	LRKT643W-EN-3090		

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
GZE161212 0-BB1	120.0	60	0.1240	14.41	0.9666


Chromaticity Measurement - Sphere-Spectroradiometer Method:

Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120.0	R1	93	R9	57
Frequency (Hz)	60	R2	96	R10	91
CCT (K)	3091	R3	98	R11	93
Duv	-0.0016	R4	92	R12	83
Chromaticity (x, y)	x=0.4284 y=0.3970	R5	93	R13	94
Chromaticity (u', v')	u'=0.2481 v'=0.5173	R6	95	R14	99
Color Rendering Index (CRI)	92.4	R7	91	R15	89
R9	57	R8	81	--	--

Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	915.02
Luminous Efficacy (lm/W)	63.50
Beam Angle (°)	100.8
Center Beam Candle Power (cd)	381

Spectral Power Distribution & Chromaticity Diagram

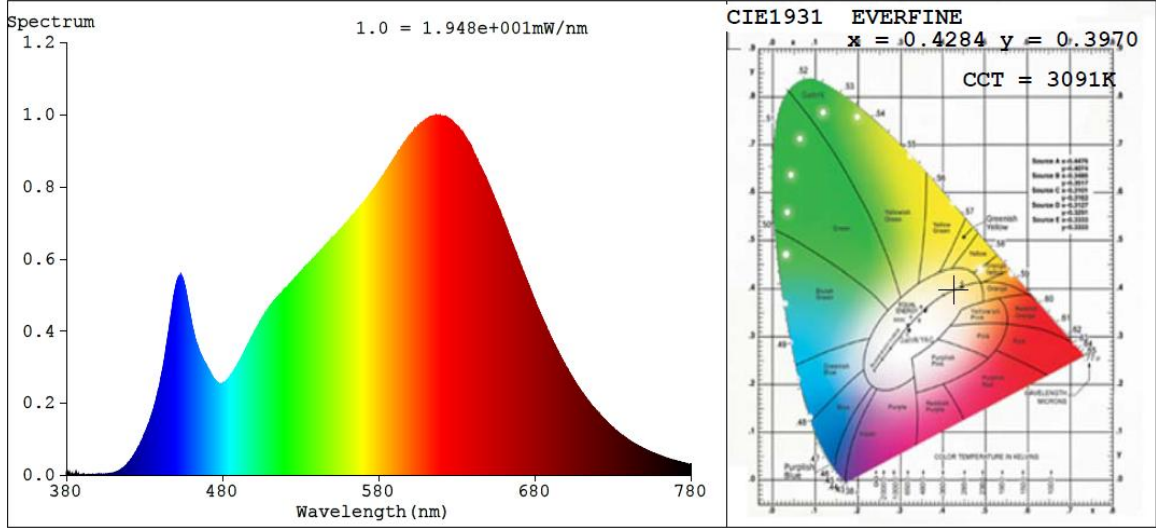


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	289.5	31.6%
0-40	465.6	50.9%
0-60	785.0	85.8%
60-90	129.0	14.1%
70-100	34.8	3.8%
90-120	0.3	0%
0-90	914.0	99.9%
90-180	0.9	0.1%
0-180	914.9	100%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	36.0	3.9%	90-100	0.1	0%
10-20	102.0	11.2%	100-110	0.1	0%
20-30	151.5	16.6%	110-120	0.1	0%
30-40	176.1	19.2%	120-130	0.1	0%
40-50	173.6	19.0%	130-140	0.1	0%
50-60	145.8	15.9%	140-150	0.1	0%
60-70	94.4	10.3%	150-160	0.1	0%
70-80	30.5	3.3%	160-170	0.1	0%
80-90	4.1	0.5%	170-180	0.0	0%



Photometric Data

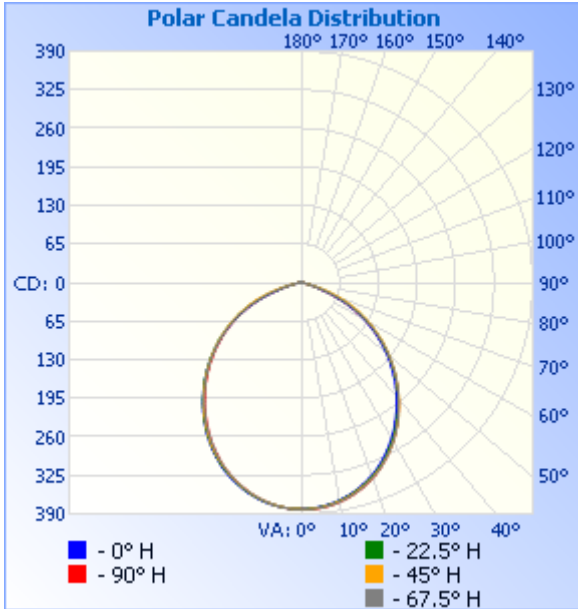

Illuminance at a Distance

	Center Beam fc	Beam Width	
17.0ft	1.32 fc	41.1 ft	40.9 ft
34.0ft	0.33 fc	82.2 ft	81.8 ft
51.0ft	0.15 fc	123.4 ft	122.8 ft
68.0ft	0.08 fc	164.5 ft	163.7 ft
85.0ft	0.05 fc	205.6 ft	204.6 ft
102.0ft	0.04 fc	246.7 ft	245.5 ft

■ Vert. Spread: 100.8°
■ Horiz. Spread: 100.6°

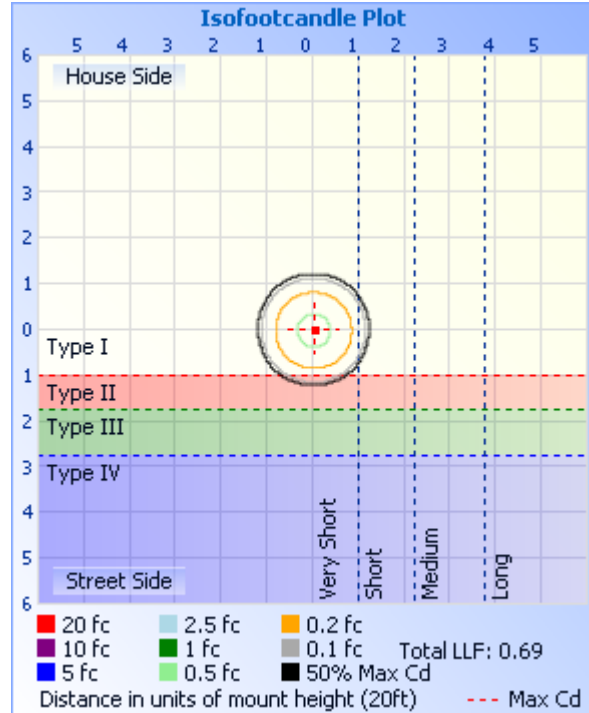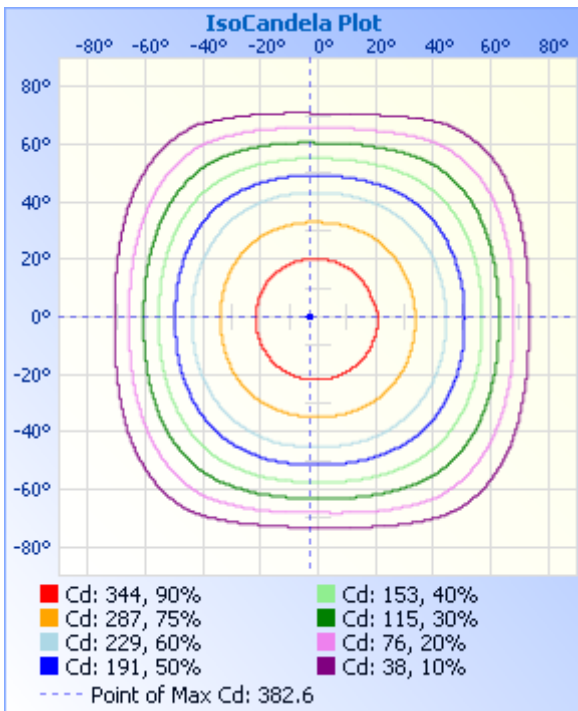

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

Candela Table - Type C

	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	360
0	381	381	381	381	381	381	381	381	381	381	381	381	381	381	381	381	381
1	381	382	382	382	383	380	381	381	381	382	382	382	382	380	380	381	381
2	381	381	382	382	382	380	381	381	381	381	381	382	382	379	380	380	381
3	380	381	381	382	382	380	380	381	381	381	381	381	381	378	379	380	380
4	380	380	381	382	382	380	380	380	380	380	380	380	380	378	378	379	380
5	379	380	380	381	381	379	379	379	380	379	379	379	380	377	377	378	379
6	378	379	379	380	380	378	379	379	379	378	378	378	378	376	376	377	378
7	377	378	378	379	379	378	378	378	378	377	377	377	377	374	375	376	377
8	375	376	377	378	378	376	377	376	377	376	376	375	376	373	373	374	375
9	374	375	375	377	377	375	375	375	375	375	374	374	374	371	371	373	374
10	372	373	374	375	375	374	374	374	373	373	372	372	372	369	370	371	372
11	370	371	372	373	373	372	373	372	372	371	370	370	370	367	368	369	370
12	368	369	370	371	372	371	370	370	370	369	368	368	368	365	366	367	368
13	366	367	368	370	370	369	369	368	368	367	366	366	366	363	364	365	366
14	364	365	366	367	368	366	367	366	366	364	364	363	363	360	361	362	364
15	361	362	363	365	365	364	364	364	363	362	361	361	360	358	359	359	361
16	358	360	361	362	363	362	362	361	361	359	359	358	358	355	356	357	358
17	355	357	358	360	360	359	359	359	358	357	355	355	355	352	352	354	355
18	352	354	355	357	357	356	357	356	355	354	353	352	352	349	350	351	352
19	349	351	353	354	354	354	354	353	352	351	349	349	349	345	347	348	349
20	346	348	349	351	351	351	351	350	349	348	346	346	346	343	344	344	346
21	342	344	346	347	348	348	347	347	346	344	343	342	342	339	340	341	342
22	339	341	343	344	344	344	344	343	342	341	339	339	339	335	337	337	339
23	335	337	340	340	341	341	341	339	339	337	336	335	335	331	333	334	335
24	331	334	336	337	336	337	337	336	335	334	332	331	331	328	329	329	331
25	326	329	331	332	332	332	333	332	330	329	328	327	327	324	325	325	326
26	322	326	328	328	328	329	329	328	327	326	324	323	322	319	321	321	322
27	317	321	323	323	324	325	326	324	322	321	320	318	318	315	316	317	317
28	313	316	319	319	319	320	321	320	318	316	316	313	313	310	313	312	313

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

29	308	312	314	314	314	315	317	315	313	312	312	309	309	306	308	308	308
30	304	306	310	310	309	310	312	311	309	307	307	304	304	301	304	302	304
31	298	302	305	305	305	305	308	306	304	303	302	300	300	297	298	298	298
32	294	296	300	300	299	301	303	302	300	298	298	295	294	292	294	293	294
33	288	292	294	294	294	295	297	296	294	294	292	291	289	287	288	288	288
34	282	286	290	290	288	289	293	291	289	288	288	285	284	282	283	282	282
35	278	281	284	284	283	285	287	286	284	284	282	280	279	277	278	276	278
36	271	276	279	279	277	279	282	280	278	278	277	275	274	272	272	272	271
37	267	271	273	273	272	274	276	276	274	272	272	269	269	267	267	265	267
38	260	265	268	266	266	268	271	270	268	268	267	264	264	261	261	261	260
39	255	260	262	261	261	263	265	265	263	262	261	259	258	257	257	255	255
40	249	253	256	255	254	257	259	259	257	257	255	254	252	251	250	249	249
41	244	248	250	250	248	250	254	253	251	251	250	248	247	246	245	244	244
42	238	242	243	243	242	245	248	248	246	245	244	242	241	240	239	238	238
43	232	236	238	238	236	239	242	242	240	240	238	237	236	234	233	232	232
44	226	231	231	231	230	234	236	237	235	234	233	231	230	229	228	226	226
45	219	224	226	225	224	227	230	231	228	229	227	226	224	223	222	220	219
46	214	218	219	219	218	220	224	224	222	223	222	220	219	218	216	214	214
47	207	212	214	213	211	215	218	219	217	216	216	214	212	210	210	209	207
48	202	205	207	206	204	208	212	213	210	211	209	209	207	206	205	202	202
49	195	199	200	201	198	202	206	206	205	205	204	202	201	200	198	197	195
50	189	192	195	193	191	195	199	201	198	199	198	197	194	193	192	190	189
51	182	187	188	188	186	188	194	194	192	193	193	191	189	188	187	183	182
52	175	180	183	181	178	183	187	189	186	186	186	184	183	181	180	177	175
53	169	174	176	173	172	176	181	182	179	181	180	179	176	177	175	171	169
54	162	167	170	167	165	169	175	175	172	174	175	172	171	170	168	164	162
55	156	161	163	160	157	163	168	169	167	169	168	165	164	163	163	158	156
56	149	154	156	154	151	156	162	162	160	162	162	160	158	157	156	152	149
57	141	147	150	146	144	150	155	157	154	155	156	153	151	151	150	145	141
58	135	141	143	140	137	142	150	149	147	150	150	148	144	145	144	138	135
59	127	133	138	133	129	135	143	142	140	143	144	141	139	139	137	132	127

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

60	121	127	130	125	123	129	136	136	134	136	138	134	132	133	132	124	121
61	113	120	125	119	115	121	130	129	126	130	131	128	126	126	125	118	113
62	107	114	117	111	107	115	123	123	120	123	125	121	119	119	120	110	107
63	99	106	110	104	100	107	116	115	113	117	119	115	111	113	113	103	99
64	90	98	104	96	91	99	110	108	105	110	113	108	105	106	106	96	90
65	84	91	97	90	85	93	103	102	98	102	106	100	97	100	100	88	84
66	75	83	91	81	76	85	97	94	90	96	99	94	91	93	93	82	75
67	69	77	83	73	69	77	89	87	82	89	93	86	83	86	87	74	69
68	60	68	76	67	61	70	82	79	75	81	86	78	75	79	80	67	60
69	54	60	69	58	53	62	76	71	66	74	81	72	68	71	72	59	54
70	46	54	61	52	47	56	68	64	59	66	73	64	60	65	66	51	46
71	38	46	55	44	39	48	60	55	51	59	66	57	52	57	58	45	38
72	33	40	47	38	33	40	54	47	43	51	59	49	45	50	52	37	33
73	27	32	41	31	27	34	46	40	36	43	51	41	38	42	44	32	27
74	23	27	33	25	22	28	39	33	29	37	43	35	33	36	38	26	23
75	19	22	26	21	19	23	32	27	25	29	37	29	27	29	30	22	19
76	17	17	21	17	15	18	24	22	20	24	29	24	22	23	24	18	17
77	14	15	16	14	13	15	19	17	16	19	24	20	19	19	19	15	14
78	11	12	13	11	11	12	14	14	14	16	18	16	15	15	15	13	11
79	10	10	10	9	9	10	12	12	12	13	14	14	12	13	12	11	10
80	8	9	8	8	8	9	9	10	10	11	12	11	11	11	10	9	8
81	7	7	7	7	6	7	8	8	8	9	9	9	9	9	8	8	7
82	6	6	6	6	6	6	7	7	7	8	8	8	8	8	7	6	6
83	5	5	5	5	5	6	6	6	6	6	7	7	7	6	6	6	5
84	4	4	4	4	4	5	5	5	5	5	5	6	6	5	5	4	4
85	3	3	3	3	3	4	3	4	4	4	4	4	4	4	3	3	3
86	2	2	2	3	2	3	2	2	2	2	3	3	3	3	2	2	2
87	1	1	1	2	2	2	1	1	1	1	1	2	2	2	1	1	1
88	0	0	1	1	1	1	1	0	0	0	0	1	1	1	0	0	0
89	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
90	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
 NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

91	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
92	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
93	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
94	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
95	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
96	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
97	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
98	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
99	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
101	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
102	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
103	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
104	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
105	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0
106	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
107	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
108	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
109	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
111	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
112	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
113	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
114	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
115	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
116	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
117	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
118	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
119	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
121	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

122	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
123	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
124	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
125	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
126	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
127	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
128	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
129	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
131	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
132	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
133	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
134	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
135	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
136	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0
137	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
138	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
139	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
141	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
142	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
143	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
144	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
145	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
146	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
147	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
148	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
149	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
151	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
152	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

153	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0
154	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
155	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
156	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
157	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
158	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
159	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

STANDARD-TECH



Report No.: GZE1612120-BB

NVLAP LAB CODE 201011-0

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road, Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>

3. Test Equipment

Equipment ID	Equipment Name	Last Calibration Date	Next Calibration Date
ST-R-336	2 meter Integrating Sphere	2016-07-01	2017-06-30
ST-R-331	Spectral analysis system HAAS-2000	2016-07-01	2017-06-30
D204	Standard Lamp	2016-07-01	2017-06-30
PF2010	Power Meter for Integrating Sphere	2016-07-01	2017-06-30
EE-09	Goniophotometer system	2016-07-01	2017-06-30
D908S	Standard Lamp	2016-07-01	2017-06-30
PF210	Power Meter for Goniophotometer	2016-07-01	2017-06-30
ST-R-181A	Temperature Tester	2016-07-01	2017-06-30
Uncertainty: Photometric Measurement (Sphere):1.74% Chromaticity Measurement(Sphere):14.3K Photometric Measurement(Goniophotometer):1.62%			

******* END OF REPORT *******

Laboratory: Standard-Tech Co. Ltd Testing Center
NVLAP CODE: 201011-0

Report Format Number STD/QR4909-A/2

Address: Standard-Tech Building, No.6 Guanhong Road,Guangzhou Science City, Guangzhou 510663, China

Tel: 8620-3229 0320 Fax: 8620-32290422 <http://www.standard-tech.com>